

# Tenor5 Flangeless Installation Instructions


for JZT5-4 and JZT5-6 Flangeless

## Cautions and Warnings

1. This product must be installed in accordance with the applicable installation code by a licensed electrician familiar with the construction and operation of the product and hazards involved.
2. Power must be OFF when connecting the fixture. "hot plugging" devices will damage the LED source.
3. The light engine is low voltage and is factory wired to the driver DO NOT CONNECT LIGHT ENGINE TO MAINS AC POWER.
4. Polarity is important. Black must be connected to black and red connected to red.


## Step A

1. Install blocking, tied to framing based upon ceiling cut-out dimensions. Cut rectangular ceiling cut-out and install sheetrock so that ceiling cut-outs and blocking align. Refer to cut-out dimensions based upon 1, 2 or 3 head configuration.

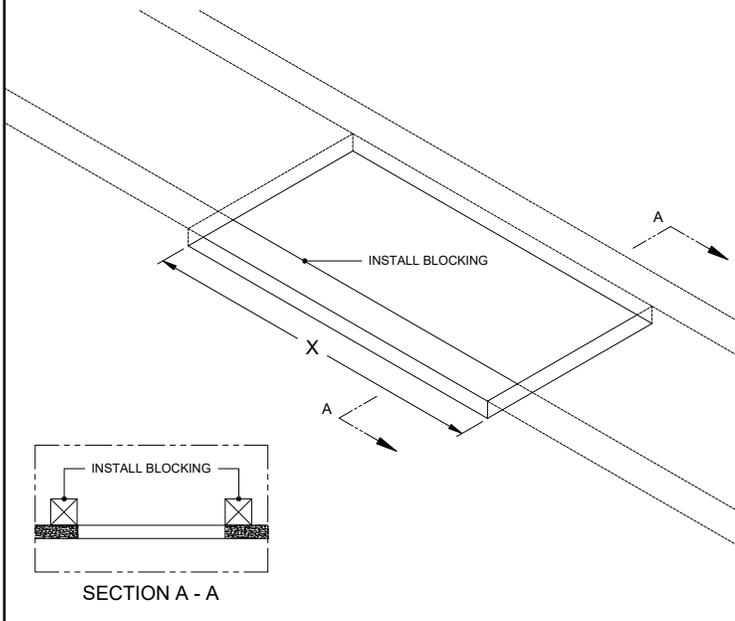


## Step B

1. Remove yoke mounting/driver plates from housings by removing (2) screws and pulling until springs retaining plate in housing are clear of housing to pull power into fixture compartment.

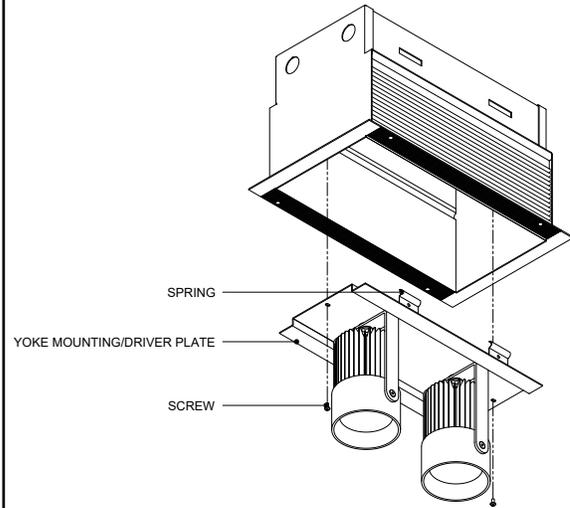

## Step C

1. Prior to installing the housing in ceiling, connect power to housing at knock-out, leaving 6" leads in place for connections to yoke mounting plate and drivers.

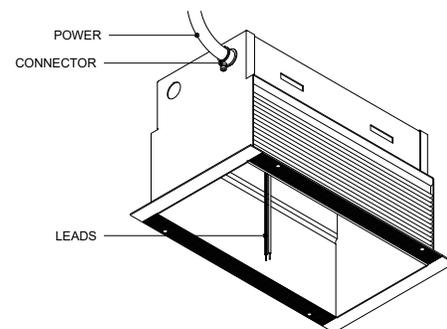


# Tenor5 Flangeless Installation Instructions

for JZT5-4 and JZT5-6 Flangeless


## Step D

1. Lift housing section into cut out until mud flange is in contact with ceiling and flush all around.

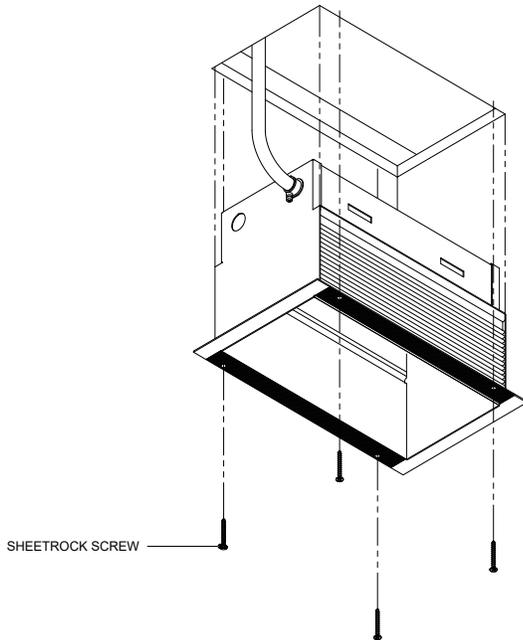


## Step F

1. Finish ceiling, including mudding or plastering mud flange. (Take care not to get paint or joint compound within housing.)

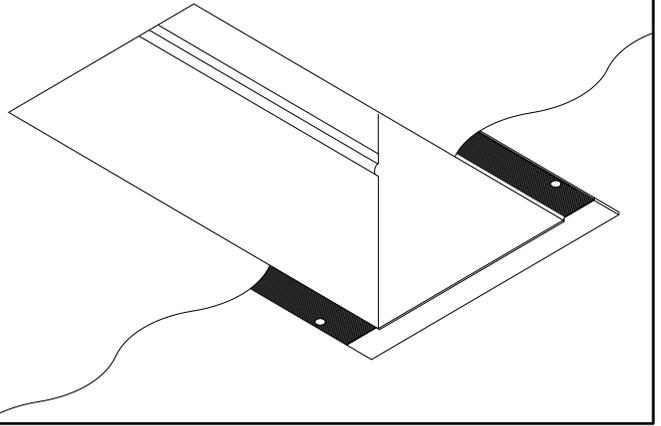

## Step G

1. Prior to reinstalling the yoke mounting/driver plates into housing, make electrical connection between housing and yoke mounting/driver plate, then secure plate to housing using supplied fasteners. Turn on power to check electrical connection.

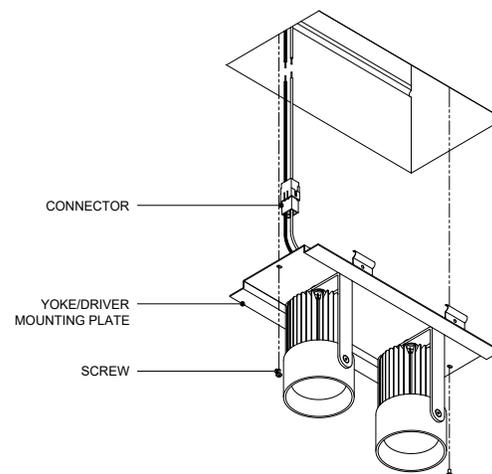

## Step E

1. Secure housing to ceiling/blocking using appropriately sized sheetrock screws to engage blocking a minimum of 3/4".

